


PLAN

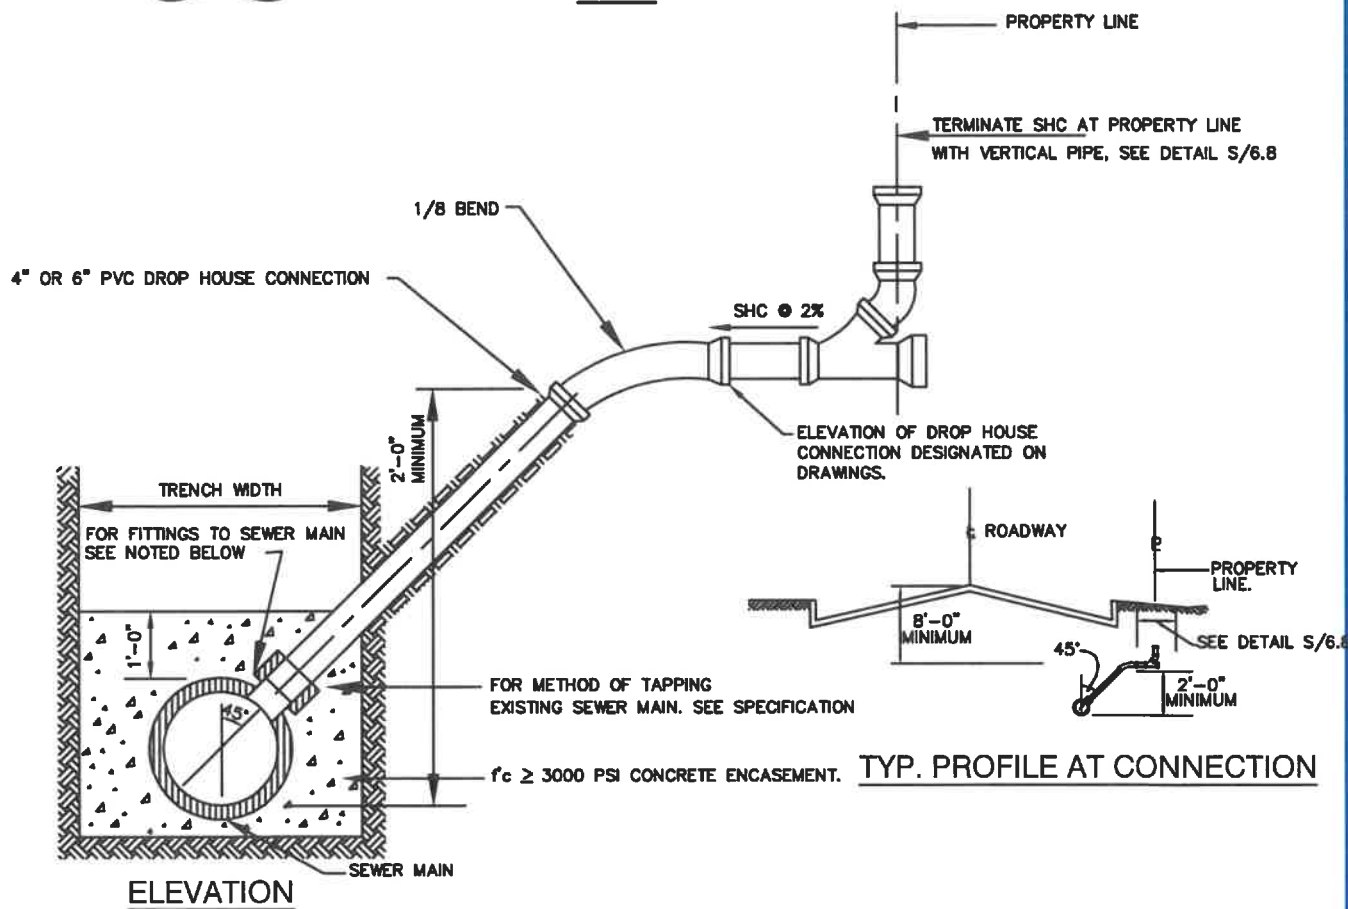

ELEVATION

CONNECTION TO SEWER MAIN NOTES:

1. FOR SEWERS LARGER THAN 15" CONNECT TO A MANHOLE.
2. TO PROPOSED SEWERS 15" AND SMALLER, USE A TEE.
3. TO EXISTING PVC 4" THRU 15" PVC SEWERS MAINS, USE SADDLE.
4. TO EXISTING DIP 12" AND SMALLER SEWER MAINS, USE SADDLE.
5. TO EXISTING SEWER MAINS OTHER THAN PVC OR DIP:
 - (A). SHC TO 4" SEWER MAINS USE TEE OR SADDLE.
 - (B). SHC 6" THRU 12" SEWER MAINS USE SADDLE.
 - (C). SHC TO 15" SEWER MAINS USE THIMBLE AND EPOXY TO MAIN LINE.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: 2-7-21  Chief Engineer	STANDARD DETAIL 4-INCH AND 6-INCH DROP HOUSE CONNECTIONS TO SEWER MAIN	S 6.0
--	---	---	----------